
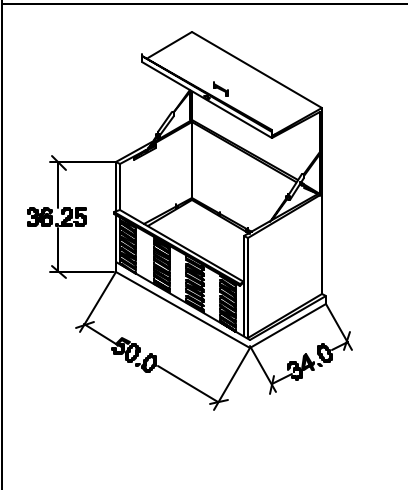
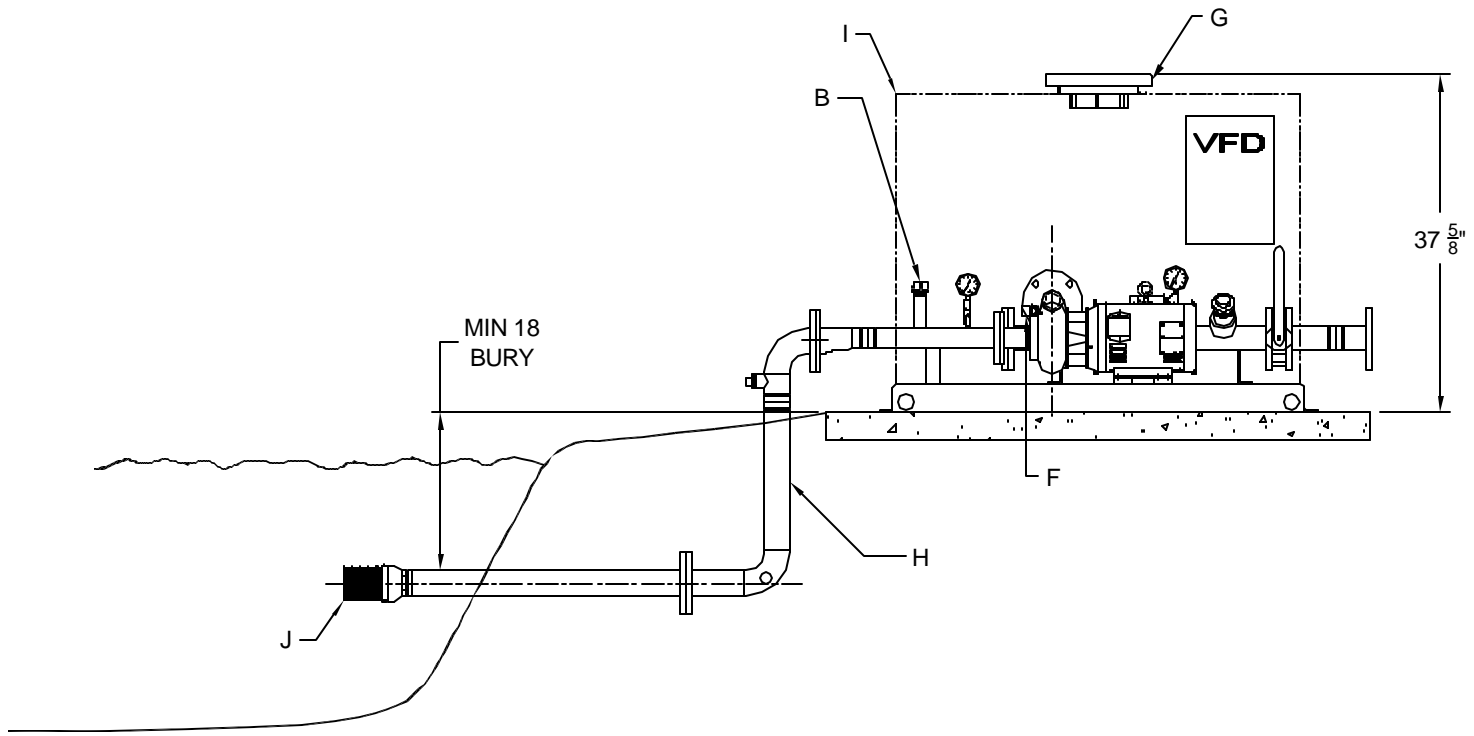


STATION COMPONENTS:

- A PUMP AND MOTOR
- B FILL PORT 1"
- C PRESSURE TRANSDUCER WITH GAUGE
- D ISOLATION VALVE
- E FLOW SENSOR
- F TEMP SENSOR
- G STATION FAN HOOD MOUNTED
- H 2.5"FLG x 2.5"FLG OR 4"FLG x 4"FLG INTAKE DROP PIPES (OPTION)
- I PAINTED STEEL ENCLOSURE
- J HIGH PRESSURE FOOT VALVE 2.5" OR 4"
- K 1" BLOW-OUT FITTING

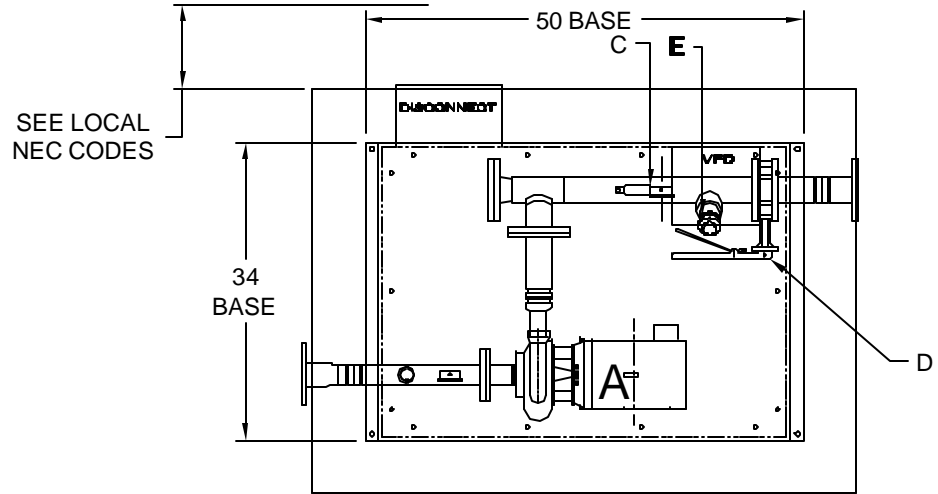

CUSTOMER APPROVAL SIGNATURE

APPROVED AS SUBMITTED

MAKE INDICATED CHANGES AND RESUBMIT

7			
6			
5			
4			
3			
2			
1	--/--	---	REVISION-NOTE:
NO.	DATE	BY	DESCRIPTION

SCALE: NONE **DRWN BY: MJW**

THIS DRAWING AND DESIGN, IS THE PROPERTY OF WATERTRONICS AND IS NOT TO BE REPRODUCED IN WHOLE OR PART, NOR EMPLOYED FOR ANY PURPOSE OTHER THAN SPECIFICALLY PERMITTED IN WRITING BY WATERTRONICS. THIS DRAWING LOANED AND SUBJECT TO RETURN ON DEMAND

TITLE:
STANDARD CLT SUCTION LIFT
CLTV-

WATERTRONICS
ELECTRONICALLY CONTROLLED PUMPING SYSTEMS
HARTLAND, WISCONSIN

DATE: 1/19/04 **SHEET 1 OF 1 SHEETS**

JOB NO.: **JOB-NO:** **DRAWING NO. STANDARD**